

ALLEY

SUBSURFACE SEWAGE DISPOSAL SYSTEM PERMIT DISCLOSURE

Version 01/01/2026



TENNESSEE DEPARTMENT OF ENVIRONMENT AND CONSERVATION APPLICATION FOR GROUND WATER PROTECTION SERVICES

1. SERVICE REQUESTED: (check service)	APPLICANT COMPLETE QUESTIONS:	FEES DUE	PTBMS CODES V689 Code Supp/Code
☒ Septic System Construction Permit			
☒ Dwelling	2, 3, 4, 7, 8, 9	\$ 500.00	78064 Yes
☐ Commercial: gpd	2, 3, 4, 7, 8, 9	\$	78064 Yes
☐ System Modification	2, 3, 4, 7, 8, 9	\$	78064 Yes
☐ Repair	2, 3, 4, 7, 8, 9	\$	
☐ Inspection Letter	2, 3, 5, 7, 8, 9	\$	78030
☐ Certificate of Verification	2, 3, 5, 7, 8, 9	\$	78032 Yes
☐ Water Sample			
☐ Total Coliform	2, 3, 6, 7, 8, 9	\$	78036 Yes
☐ Fecal Coliform	2, 3, 6, 7, 8, 9	\$	78038 Yes
☐ Alternative System Permit*		\$	78068
☐ Large Conventional System Plan Review*		\$	78090
☐ Large Alternative System Plan Review*		\$	78090
☐ Experimental System Plan Review*		\$	78072
☐ Subdivision Evaluation: Lots:		\$	78084
☐ Soil Mapping: Type Acres		\$	Yes
☐ Installer Permit: Type(s)		\$	78028 Yes
☐ Pumper Permit*		\$	78028
☐ Plat Approval — Individual Lot		\$	78029
☐ Domestic Septage Disposal Site Permit		\$	78031

*Applicant may review these service requests with Environmental Specialist prior to processing application.

2. LANDOWNER:	APPLICANT	ORIGINAL OWNER
Names: <u>Thad Winchester</u>	Name: <u>JW Church</u>	Name: _____
Address: <u>1340 Raders Dr</u>	Address: <u>same</u>	
<u>Greeneville, TN 3743</u>		
Day Phone: _____	Day Phone: <u>302-7693</u>	

3. LOCATION OF LOT OR SITE: a) In a subdivision? ☒ b) Name: Dollie Bible Prop Lot # 5
b) Non-Subdivision Give specific directions and address to the lot or site: _____

4. FOR SSDS PERMIT ONLY: a) Size of lot _____ b) Number of Bedrooms 1
c) How many occupants? 1 d) Excavated Basement? Yes _____ No ☒
e) Basement Plumbing Fixtures? Yes _____ No ☒
f) Amount of water used monthly (gallons) _____
g) Water Supply: Public ☒ Well _____ Spring _____
h) Is the lot staked? ☒ If not, date it will be staked: _____
Is the house staked? ☒ If not, date it will be staked: _____ House is there
i) Installer, if known: unknown

5. FOR INSPECTION LETTER ONLY: Will pick up _____ Please mail _____
a) Age of house _____ b) Is house vacant? _____ How long? _____
c) Original sewage system inspected _____
d) Date of previous repairs _____ Inspected _____
e) Is waste water "backing up" into plumbing fixtures? _____ Surfacing on the ground? _____
f) All waste water including washing machines routed into septic tank _____

6. FOR WATER SAMPLE ONLY: a) Source of Supply: Spring _____ Well _____
b) Is there an outside faucet? _____ c) Is the source chlorinated? _____
d) For Wells: Is the casing 6" above the ground? _____ Is a sanitary seal on the casing? _____

7. MAKE A ROUGH SKETCH ON BACK OF THIS WHITE PAGE SHOWING DIRECTIONS TO PROPERTY, PROPERTY LINES, HOUSE SITE, WELL LOCATION, SPRING LOCATION, PLANNED DRIVEWAY AND UTILITIES.

8. ALL FEES DUE IN ADVANCE AND ARE NON-REFUNDABLE (except upon appeal). See Fee Schedule on reverse. Make check payable to: **TREASURER, STATE OF TENNESSEE**

9. I certify that the above information is true and correct to the best of my knowledge, and that I have been authorized by the above named landowner to submit this Application for Environmental Services to the Division of Ground Water Protection.

DATE: 12/9/13 SIGNATURE: X [Signature] AMOUNT PAID: \$ 500.00 RECEIPT NUMBER 1979

White: File Canary: Owner

DEPARTMENT OF ENVIRONMENT AND CONSERVATION



DIVISION OF GROUND WATER PROTECTION

CERTIFICATE OF COMPLETION OF SUBSURFACE SEWAGE DISPOSAL SYSTEM

Issued to:

Winchester, Thad
Owner, Developer, Contractor, Installer, Etc.

Location:

1340 Raders Sidetrack Rd

Type of system

- ☒ 1. Conventional
☐ 2. Low Pressure Pipe
☐ 3. Mound
☐ 4. Lagoon
☐ 5. Large Diameter Gravelless Pipe
(a) Sand backfill required Yes () No ()

() 6. Other


NAITON 750
(type) (volume)

Septic Tank

Estimated Absorption Rate 75 MPI
(minutes per inch)

☒ New Installation ☐ Repair ☐ Other

Installed by: Clifford Brown

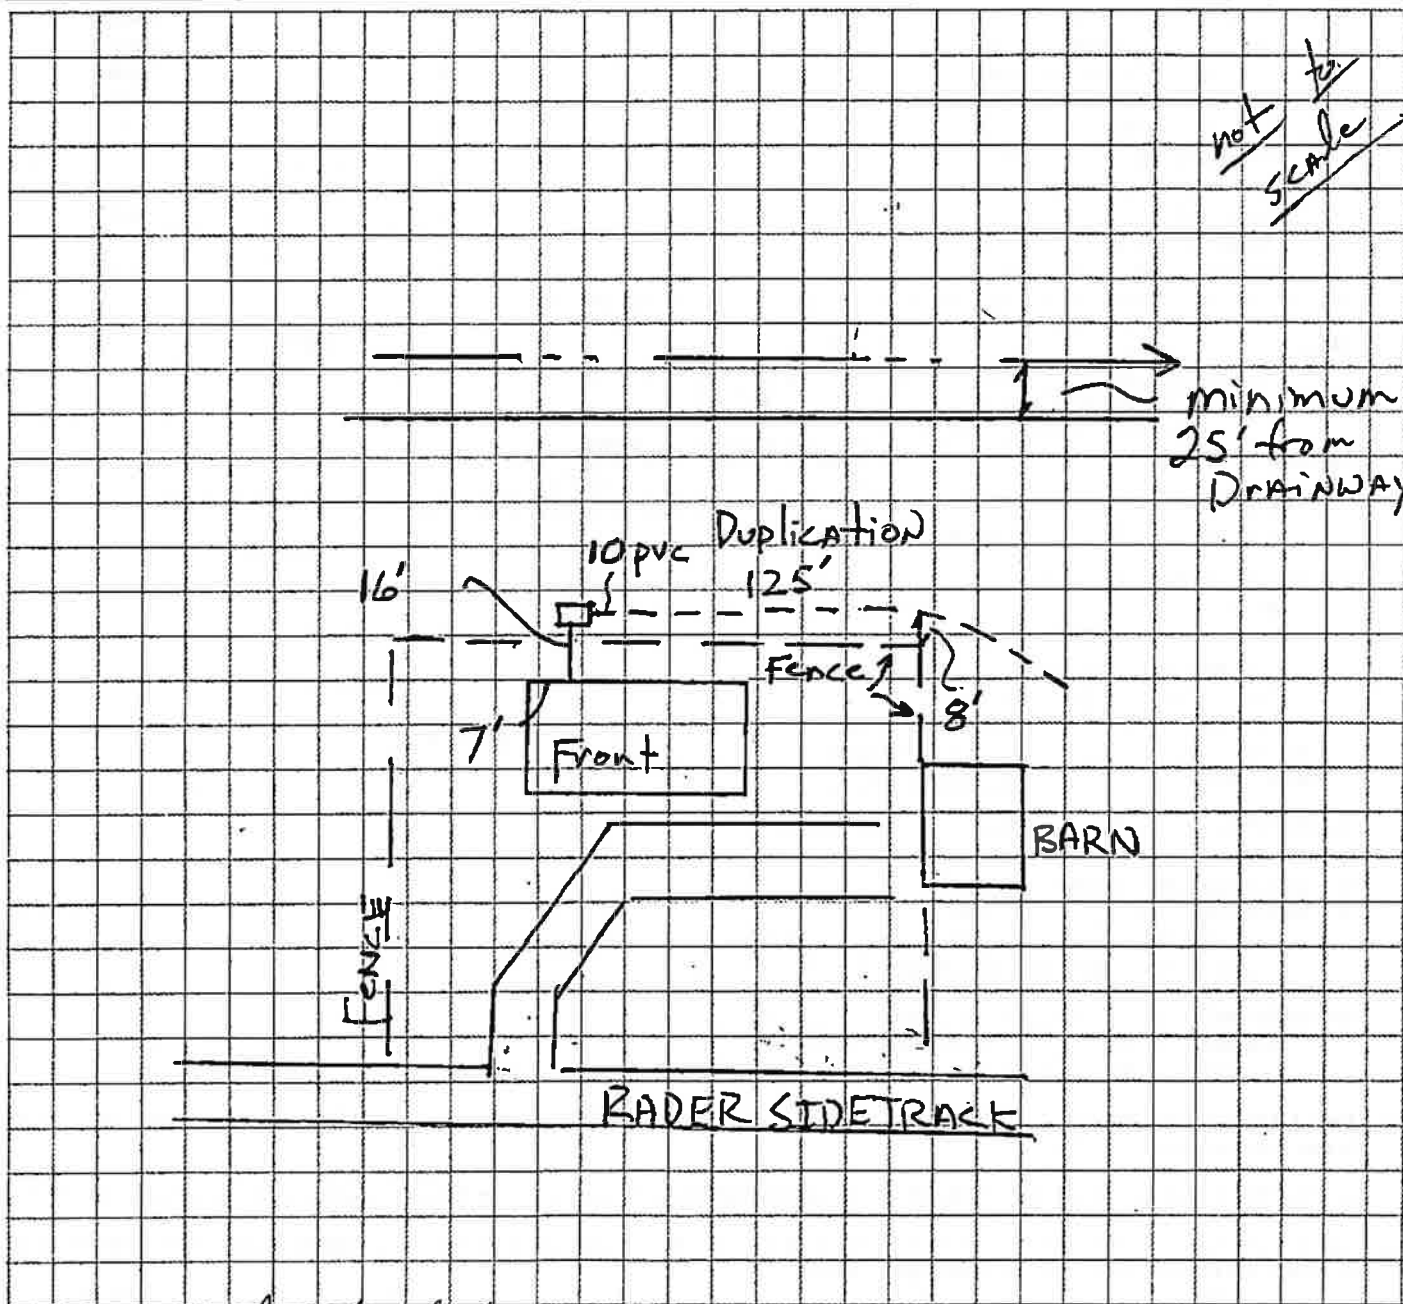

Construction Approved By:

Jeff White ES III
(Name and Title)

2/7/14
(date)

Property owner

TENNESSEE DEPARTMENT OF ENVIRONMENT AND CONSERVATION
DIVISION OF GROUND WATER PROTECTION
PERMIT FOR CONSTRUCTION OF SUBSURFACE SEWAGE DISPOSAL SYSTEM

Issued to: Winchester, Thad
Owner, Developer, Contractor, Installer, Etc.
Location: Occupant - J.W. Church

Installation: 1340 Raders Sidetrack Rd.
☒ 1. New Installation
☒ 2. Repair to Existing System
Establishment: 1
☒ 1. Residential: # Bedrooms 1
☐ 2. Other: _____ (specify)

Go/Day _____

Evaluation Based Upon:
☐ 1. Soil typing by Soil Scientist
☐ a. General
☐ b. High Intensity 24-28"
☐ c. Extra High Intensity
☐ 2. Soil Percolation Test
☒ 3. Environmental Specialist
Estimated Absorption Rate: 25 MPI

Approval based upon:
Statute No. T.C.A. 68-221-403
☐ (c) Percolation test
☐ (d) Grandfather clause. Current standards except those specified
☐ (f) 12" (karst) and 6" (non-karst) buffer required

Type of System:
☒ 1. Conventional
☒ 2. Low Pressure Pipe Gravel Backfill
☐ 3. Mound
☐ 4. Lagoon
☒ 5. Large Diameter Gravelless Pipe
☐ a. Sand backfill required
☒ 6. Other As per regulations

☐ (i) 9" buffer required (24"-36" total soil depth)
☐ (k) Grandfather clause — meets June 30, 1990 standards (repair only)
☒ Other Current standards

This system shall consist of a two compartment septic tank holding 750 or larger gallons, with 125 linear feet in 1 trenches, 36 inches wide and 24-28 inches deep. (Depth of gravel: 12 inches)

Also required:
☐ 1. Soil Improvement Practice (SIP)
☐ 2. Flow Diversion Valve
☐ 3. Sewage Pump
☐ 4. Other: _____

All installers of subsurface sewage disposal systems must hold a valid annual license from the Tennessee Department of Environment and Conservation.

The recipient of this permit agrees to construct or have constructed the above described system in accordance with T.C.A. 68-221-401 et. seq. and The Regulations To Govern Subsurface Sewage Disposal Systems. If any part of the system is covered before being inspected and approved, it shall be uncovered by the recipient of the permit at the direction of personnel of the Department of Environment and Conservation. Any cutting, filling or alterations of the soil conditions on the aforementioned property after this day may render this approval null and void.


Signature of Recipient: J.W. Church Date: 12-17-13

Issued at: Greenville Tennessee, in Greene County

By: Jeff Davis ESII Date: 12/13/13
(Name and Title) (Date of Issue)

CALL BEFORE 9:00 AM FOR INSPECTION
INSTALL ON CONTOUR 6' BETWEEN TRENCHES
STAY 10' FROM PROPERTY LINE, WATER LINE
AND UTILITIES

This permit is valid for 3 years from date of issue.

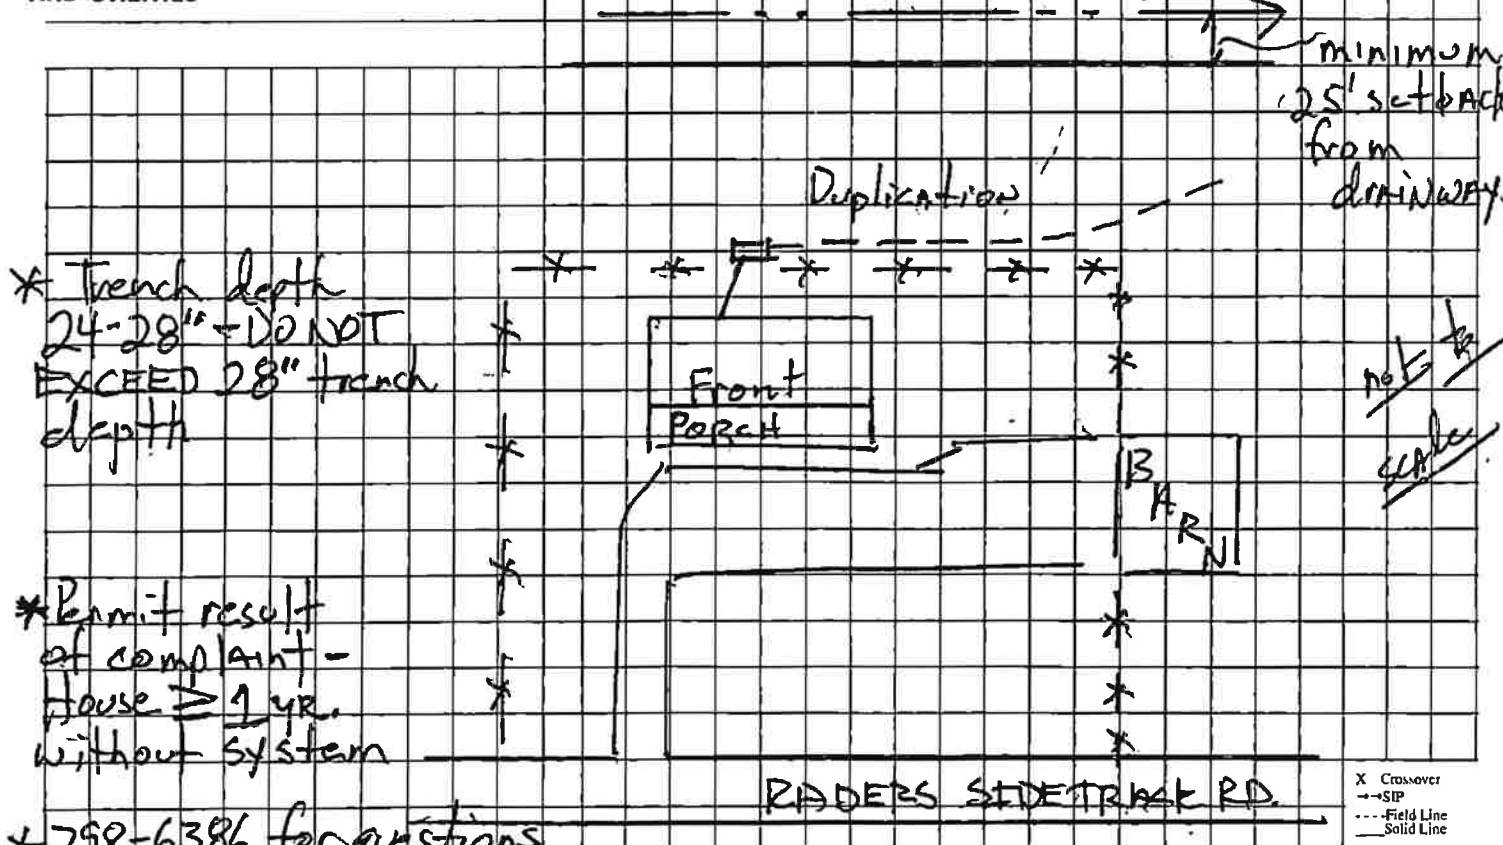

This is a permit to construct and is not intended to imply approval of any work proposed or completed on this lot.



